

Digital Tach/Hourmeter with Overspeed Trip Point Installation Instructions for SHD45 Model



Please read the following information before installing. A visual inspection for any damage which may have occurred during shipping is recommended. It is your responsibility to have a qualified person install the unit, and make sure it conforms with NEC and local codes.

GENERAL INFORMATION

⚠ WARNING

BEFORE BEGINNING INSTALLATION OF THIS MURPHY PRODUCT

- ✓ Disconnect all electrical power to the machine.
- ✓ Make sure the machine cannot operate during installation.
- ✓ Follow all safety warnings of the machine manufacturer.
- ✓ Read and follow all installation instructions.

Description

The SHD45 is a microprocessor-based digital tachometer and hourmeter with an overspeed trip point. The overspeed trip point can be connected as either a form "B" relay output or as a normally open SCR output.

In Class I, Div. 2, hazardous locations the SHD45 form "B" relay contact is restricted for use with Murphy **non-incendive** instruments. In non-hazardous locations the relay contact may be used to switch resistive loads not exceeding 0.5 A @ 30 VDC or 125 VAC.

When connected as a normally open SCR, the output is rated 0.5 A, 350 VDC continuous and can switch up to 3 A @ 350 VDC momentary. The SCR output may be used to switch designated overspeed normally open sensor inputs.

Specifications

Power input:

CD ignition: 90 to 350 VDC. 150 μ A typical @ 90 VDC; 300 μ A @ 350 VDC.
 Magnetic Pickup: 5 to 120 Vrms. 325 μ A typical @ 5 Vrms, 100 Hz;
 450 μ A typical @ 5 Vrms, 1 kHz; 1 mA typical @ 5 Vrms, 5 kHz;
 2 mA typical @ 5 Vrms, 10 kHz; 15 mW max. @ 5 Vrms,
 10 kHz; 2.8 W max. @ 120 Vrms, 10 kHz.

Backup Batteries: 2 replaceable, long life Lithium, 3.5 V, 350 mA power.
 Shelf life expectancy 10 years.

Operating Temperature: -4° to 158°F (-20° to 70°C).

Storage Temperature: -40° to 300°F (-40° to 150°C).

Case Material: Glass-filled molded nylon.

Ignition Frequency Range: 3 to 666 Hz.

Magnetic Pickup Frequency Range: 1 to 10 kHz.

Overspeed Output: Connected to Normally Open terminals: S.C.R. (Silicon Controlled Rectifier) 0.5 A, 350 VDC continuous.

Connected to "Form B" Relay output terminals: 0.5 A, 30 VDC, 125 VAC resistive.

Tachometer Accuracy: $\pm 0.5\%$ of the display reading; or ± 1 RPM whichever is greater.

Hourmeter Range: 0 to 65535 hrs.

Hourmeter Accuracy: ± 15 minutes per year.

Laboratory Approvals: CSA (Canadian Standards Association) approved for Class I, Division 2, Groups C & D hazardous areas.

Shipping Weight : 3 lb (1.4 kg).

Shipping Dimensions: 10 x 9-1/2 x 6 in. (254 x 241 x 152 mm).




Approved for Class I, Division 2,
 Groups C & D Hazardous Areas

*When installed per Murphy Drawing 20-08-0255 Revision C.
 Call Murphy for Details.


Mounting

The SHD45 is designed for installation in panels from 0.032 to 0.125 in. (1 to 3 mm) thick. A round hole, 4-3/4 in. (121 mm) in diameter is needed for mounting. Install the unit within a weatherproof enclosure to protect it from the elements. Keep the unit away from ignition coils and coil leads; a minimum of 12 in. (305 mm) is recommended.

SHD45 Dimensions

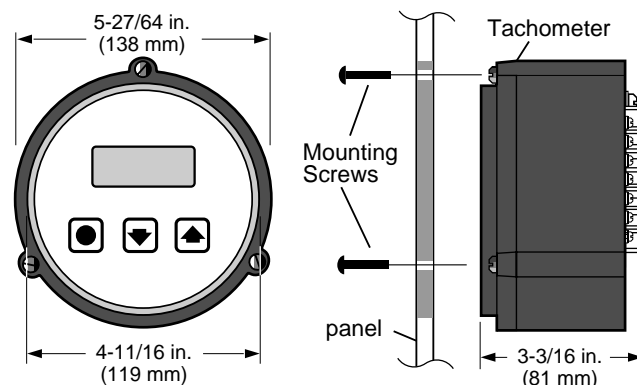

Mounting Hole

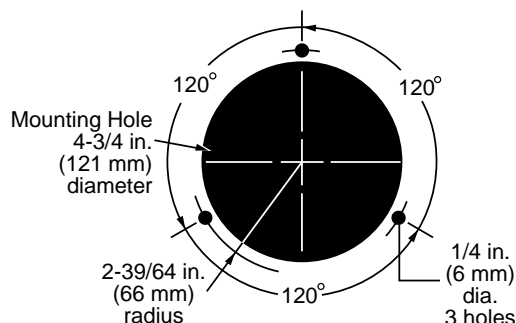

TYPICAL WIRING



WARNING: PERFORM THE WIRING INSTALLATION WITH THE POWER SOURCE OFF. NEVER ROUTE THE SHD45 OVERSPEED OUTPUT LEADS WITH PRIMARY IGNITION WIRING.

Connecting the Magnetic Pickup

Connect the magnetic pickup cable conductors to the 6 connector terminal strip as shown in **Figure 2**. Use a two conductor shielded cable between the SHD45 and the magnetic pickup.

Figure 2: SHD45 to magnetic pickup typical wiring

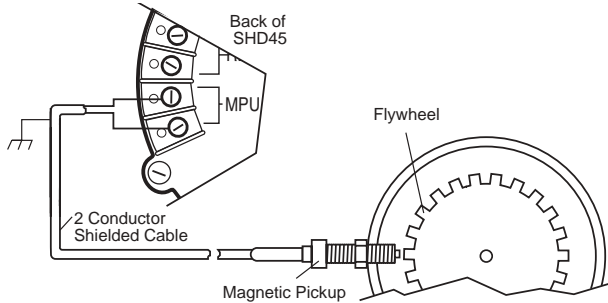


Table 1: Output Voltage & Polarity of Common CD Ignitions

Ignition MFG & Series	Ground Polarity	Peak Output Voltage	Use Figure
Altronic I & V	Negative	120	3
Altronic III	Negative	225	3
Altronic II	Positive	350	4
Bendix S-1800, BLAR	Negative	250	3
Bendix Side-winder	Positive	300	4
Fairbanks Morse SCSA	Positive	180	4
Fairbanks Morse 3000 & 9000	Negative	225	3
American Bosch Magtronic	Negative	165	3

Connecting to CD Ignition

Before wiring the SHD45, determine the output voltage and ground polarity of the ignition. **Table 1** (below, left) lists the Peak Output Voltage and Ground Polarity of some common ignitions.

Connect the SHD45 to a positive or a negative ground CD ignition as shown in **Figures 3 or 4**.

Figure 3: SHD45 typical wiring for NEGATIVE ground ignition


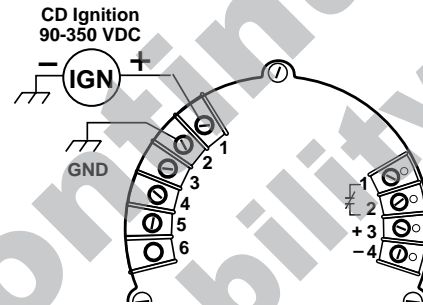


Figure 4: SHD45 typical wiring for POSITIVE ground ignition

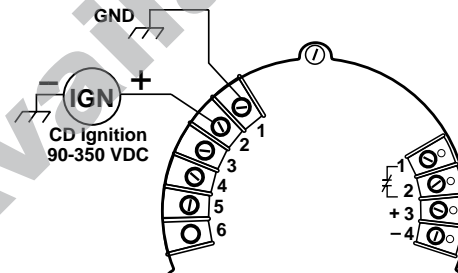


OVERSPEED OUTPUT WIRING

Connecting the Overspeed Output


A 4-conductor terminal strip, on the back of the SHD45, is provided for connection of the overspeed output. Terminals 1 and 2 are used for connecting the output as a normally closed relay contact. Terminals 3 and 4 are used for connecting the output as a normally open SCR output. Shown in **Figure 5** is a typical wiring installation of the SHD45 normally closed relay output connected to a Murphy MARK III digital fault annunciator. Shown in **Figure 6** is a typical wiring of the SHD45

Figure 5: SHD45 Normally Closed Relay output to MARK III

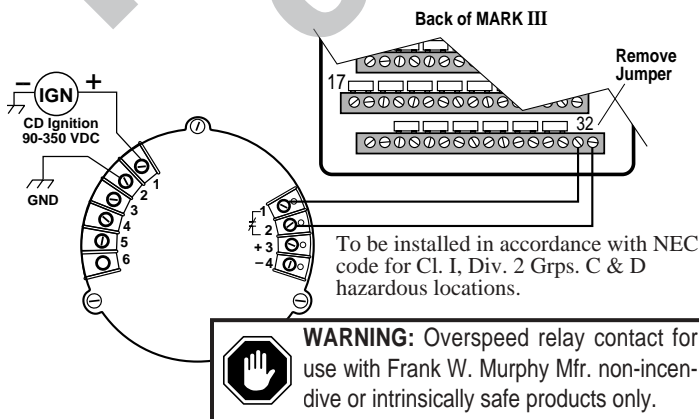

normally open SCR output connected to a Murphy MARK III digital fault annunciator. **Figure 7** displays a typical wiring of the SHD45 normally open SCR output to a Murphy MARK II annunciator. **Figure 8** displays a typical wiring of the SHD45 normally open SCR output to a Murphy MARK IV annunciator. **Figure 9** displays a typical wiring of the SHD45 normally closed relay output to a Murphy LCDT-NC annunciator. **Figure 10** displays a typical wiring of the SHD45 normally open SCR overspeed output to a Murphy LCDT-NO annunciator.

Figure 6: SHD45 Normally Open SCR output to MARK III

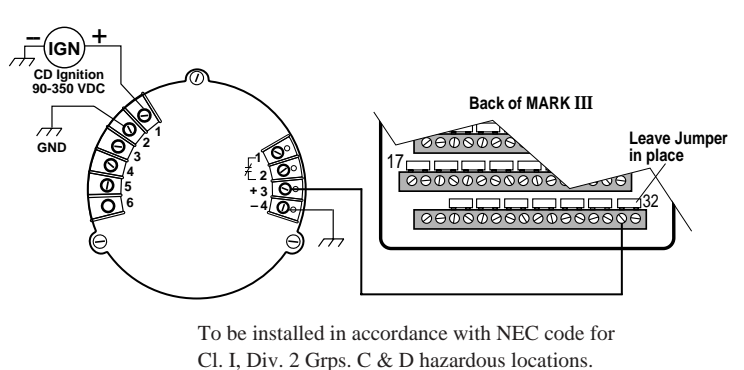


OVERSPEED OUTPUT WIRING *continued*




WARNING: PERFORM THE WIRING INSTALLATION WITH THE POWER SOURCE OFF. NEVER ROUTE THE SHD45 OVERSPEED OUTPUT LEADS WITH PRIMARY IGNITION WIRING.

Figure 7: SHD45 Normally Open SCR output to MARK II

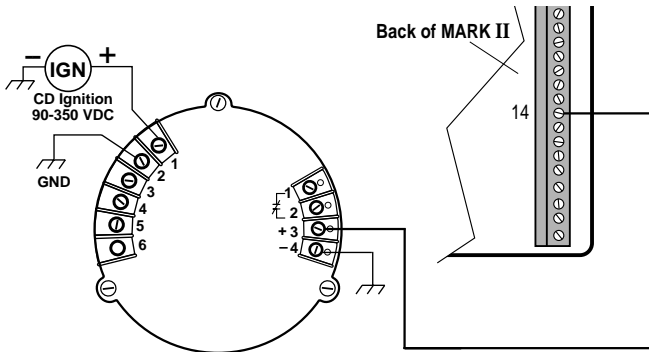


To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.

Figure 8: SHD45 Normally Open SCR output to MARK IV

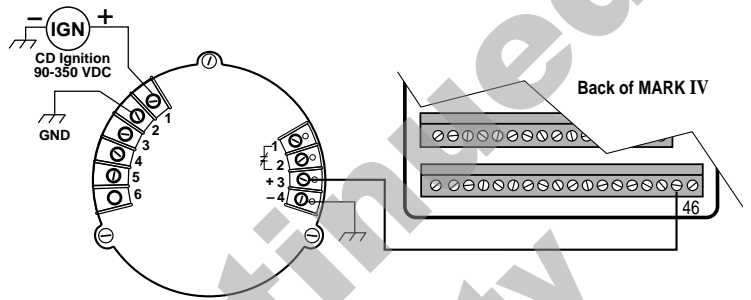

To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.

Figure 9: SHD45 Normally Closed Relay output to LCDT-NC

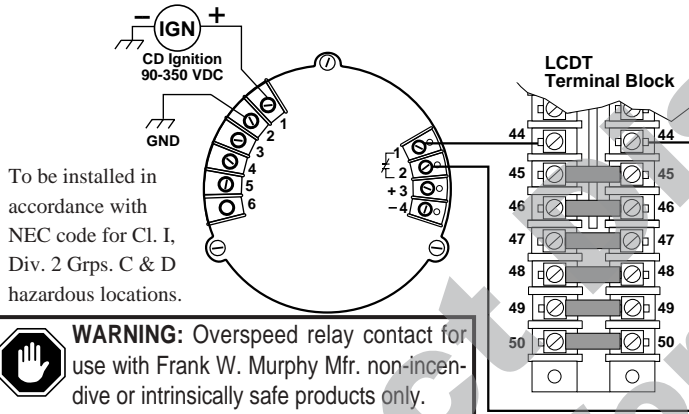


To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.



WARNING: Overspeed relay contact for use with Frank W. Murphy Mfr. non-incendive or intrinsically safe products only.

Figure 10: SHD45 Normally Open S.C.R. output to LCDT-NO

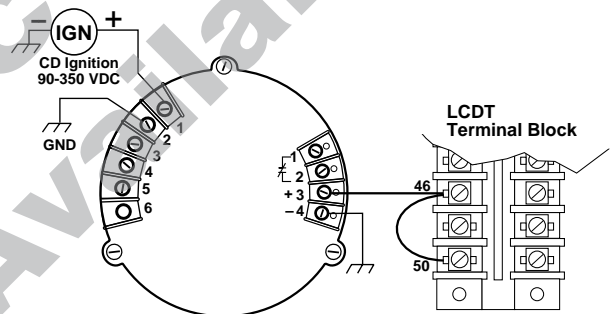


To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.

TYPICAL WIRING FOR CONTROL PANEL

Shown below is the SHD45 with SCR output connected to TATTLE-TALE® magnetic switches and SWICHGAGE® instruments using an

Figure 11: SHD45 with Normally Open S.C.R. output typical wiring for negative ground ignition systems.

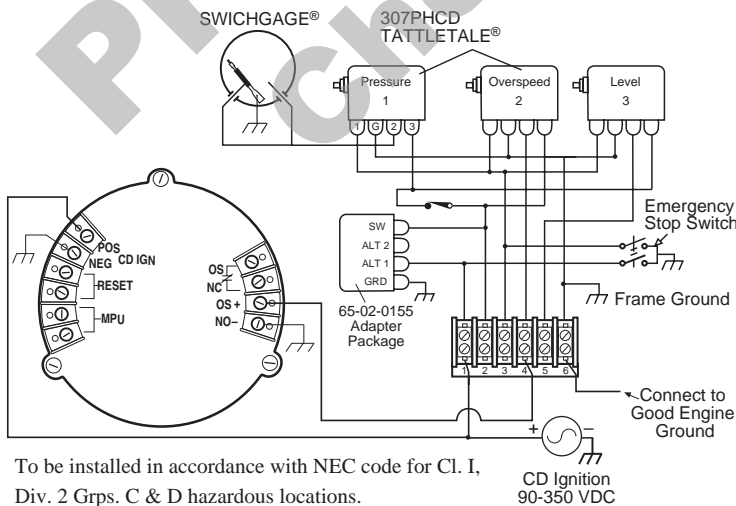


To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.

CD Ignition
90-350 VDC

adapter package. **Figure 11** shows a typical wiring for negative ground ignition. **Figure 12** shows a typical wiring for positive ground ignition.

Figure 12: SHD45 with Normally Open S.C.R. output typical wiring for positive ground ignition systems.

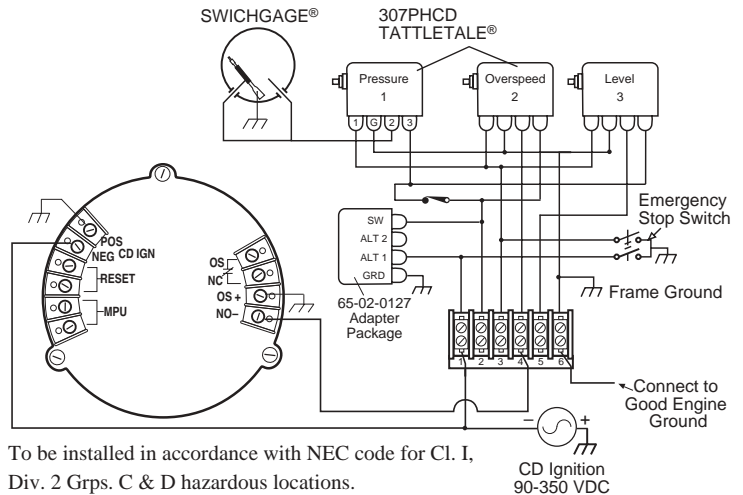

To be installed in accordance with NEC code for Cl. I, Div. 2 Grps. C & D hazardous locations.

CD Ignition
90-350 VDC

Resetting the Run Hours

To reset the Run hours to zero, place a jumper between terminals (terminals #3 and #4 of the 6-point terminals). Press and hold the Reset Relay Read Hours key on the SHD45 faceplate for 5 seconds. The Run Hours will be reset to zero.

Presetting the Run Hours

To preset the run hours first you must reset the run hours (see the above paragraph). After resetting the hours continue to hold the Reset Relay Read Hours key for another 5 seconds. The run hours will flash 3 times. At this point the hours can be preset in hours using the up/down keys to increase or decrease the hours. When the desired preset run hours is reached, continue holding the Reset Relay Read Hours key for another 5 seconds. The run hours must flash 3 times indicating the run hours value has been saved.

Pulses Per Revolution Adjustments

The SHD45 measures RPM based on the number of pulses per engine revolution. Pulses can come from either an ignition or a magnetic pickup. For an ignition, the number of pulses per revolution is determined by the number of cylinders and cycles, refer to **Table 2**.

For magnetic pickup, the number of pulses per revolution is simply the number of teeth on the gear. To adjust the pulses per revolution do the following:

1. Press and hold the Reset Relay Read Hours key. Run hours will be displayed. Continue to hold the Reset Relay Read Hours key.
2. Press the DOWN key and hold for 5 seconds. The current pulses per revolution value will flash indicating that it now can be changed.
3. Continue to hold the Reset Relay Read Hours key. Use the the UP/DOWN keys to increase and decrease the number of pulses per revolution. Once the desired value is displayed, continue holding Reset Relay Read Hours key for 5 seconds, the display must flash 3 times indicating that the new value is saved (the display MUST flash 3 times for the new value to be saved).

Table 2: Cylinders, Cycles, Pulses Per Revolution

Cylinders	Cycles	Pulses	Cylinders	Cycles	Pulses
1	2	1	6	2	6
2	2	2	6	4	3
2	4	1	8	2	8
3	2	3	8	4	4
4	2	4	10	4	5
4	4	2	12	4	6
5	2	5	16	4	8

NOTE: Divide the number of cylinders by 2 for split capacitor ignitions. Multiply the number of cylinders by 2 for throw away spark ignitions.

Overspeed Set Point Adjustments

To adjust the overspeed set point perform the following steps:

1. Press and hold the Reset Relay Read Hours key. Run hours will be displayed. Continue to hold the Reset Relay Read Hours key.
2. Press the UP key and hold for 5 seconds. The current overspeed set point value will flash indicating that it now can be changed.
3. Continue to hold the Reset Relay Read Hours key. Use the UP/DOWN keys to increase and decrease the number of overspeed set point. Once the desired value is displayed, continue holding the Reset Relay Read Hours key for 5 seconds, the display will flash 3 times indicating that the new value is saved (the display MUST flash 3 times for the new value to be saved).

Operation Sequence

When the SHD45 receives a tach signal, it begins displaying RPM. When the RPM reading is flashing, it means that the overspeed setting has been tripped (see *Overspeed Output Tripped*, below).

Run Hours Display

To display the run hours, press Reset Relay Read Hours key. The run hours will be displayed for 5 seconds before returning to RPM.

To configure the SHD45 to automatically toggle between displaying rpm and run hours, press the Reset Relay Read Hours key twice quickly. The display will toggle between displaying rpm for 6 seconds, and run hours for 2 seconds. The setting is saved and does not have to be performed every time the unit is powered up. Press the Reset Relay Read Hours key twice again to return to displaying rpm only.

Overspeed Set Point Display

To display the overspeed set point, press the UP key. The current overspeed set point will be displayed for 5 seconds before returning to RPM.

Overspeed Output Tripped

When RPM exceeds the overspeed setting, the normally open SCR output trips and latches, and the normally closed relay output opens. To reset the relay output, press Reset Relay Read Hours key after RPM has fallen below overspeed set point. The current through the SCR must be broken to allow the SCR to reset in addition to pressing Reset Relay Read Hours key.

Pulses Per Revolution Display

To display the pulses per revolution, press the DOWN key. Current pulses per revolution will be displayed for 5 seconds before returning to RPM.

Replacing the Backup Batteries

Backup batteries are provided to allow display of the run hours and for resetting the overspeed relay after power is lost. To replace the batteries, first remove the SHD45 from the panel. Remove the 3 screws located on the back of the SHD45 and VERY CAREFULLY remove the face plate. The 2 on-board batteries are above the circuit board. Replace existing batteries with new ones observing polarity (batteries are available from a Murphy dealer). Replace the face plate and the screws. Remount the SHD45 on panel.

Warranty

A two year limited warranty on materials and workmanship is provided with this Murphy product. Details are available on request and are packed with each unit.



FWMurphy

P.O. Box 470248
Tulsa, Oklahoma 74147 USA
(918) 317-4100
fax (918) 317-4266
e-mail sales@fwmurphy.com
www.fwmurphy.com

CONTROL SYSTEMS & SERVICES DIVISION
P.O. Box 1819; Rosenberg, Texas 77471; USA
(281) 342-0297 fax (281) 341-6006
e-mail sales@fwmurphy.com

MURPHY DE MEXICO, S.A. DE C.V.
Blvd. Antonio Rocha Cordero 300, Fracción del Aguaje
San Luis Potosí, S.L.P.; México 78384
+52-444-8206264 fax +52-444-8206336
e-mail ventas@murphymex.com.mx
www.murphymex.com.mx

FRANK W. MURPHY, LTD.
Church Rd.; Laverstock, Salisbury SP1 1QZ; U.K.
+44 1722 410055 fax +44 1722 410088
e-mail sales@fwmurphy.co.uk
www.fwmurphy.co.uk

MURPHY SWITCH OF CALIFORNIA
41343 12th Street West
Palmdale, California 93551-1442; USA
(661) 272-4700 fax (661) 947-7570
e-mail sales@murphyswitch.com
www.murphyswitch.com

MACQUARRIE CORPORATION
1620 Hume Highway
Campbellfield, Vic 3061; Australia
+61 3 9358-5555 fax +61 3 9358-5558
e-mail murphy@macquarrie.com.au

